


14-Day Summary

06/03/2025-20/03/2025 | Report Generated: 20/03/2025

Time in Ranges

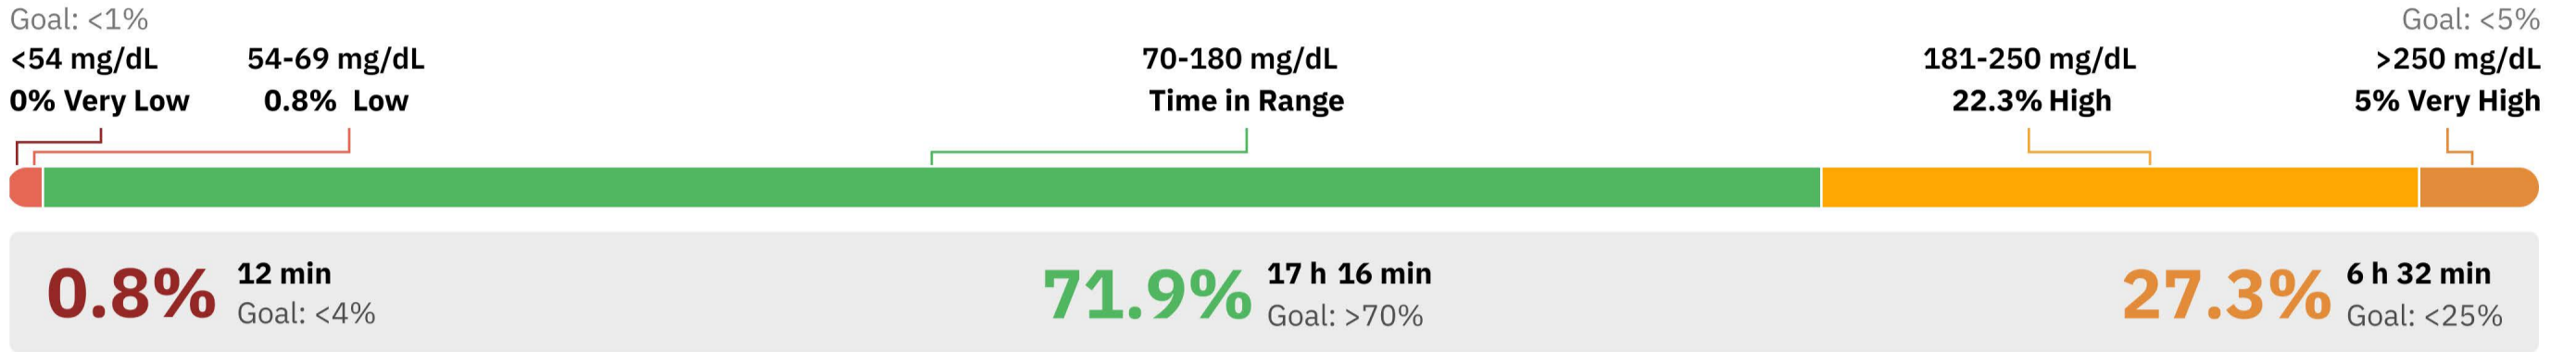

Glucose Metrics

Average Glucose
156 mg/dL

Glucose Variability (CV*)
30.4% Goal: ≤36%
*Coefficient of variation

Glucose Mgmt Indicator (GMI)
7.1% Goal: <7%

Standard Deviation (SD)
47.6 mg/dL

Device Use | Omnipod 5 & Dexcom G7




Active Pod Wear Time **99%**

Avg Pod Wear Time **2.4 Days (58 hrs)**

Connected Sensor Time **99%**

Ambulatory Glucose Profile (AGP)

AGP is a summary of glucose values from the report period, with median (50%) and other percentiles shown as if they occurred in a single day.

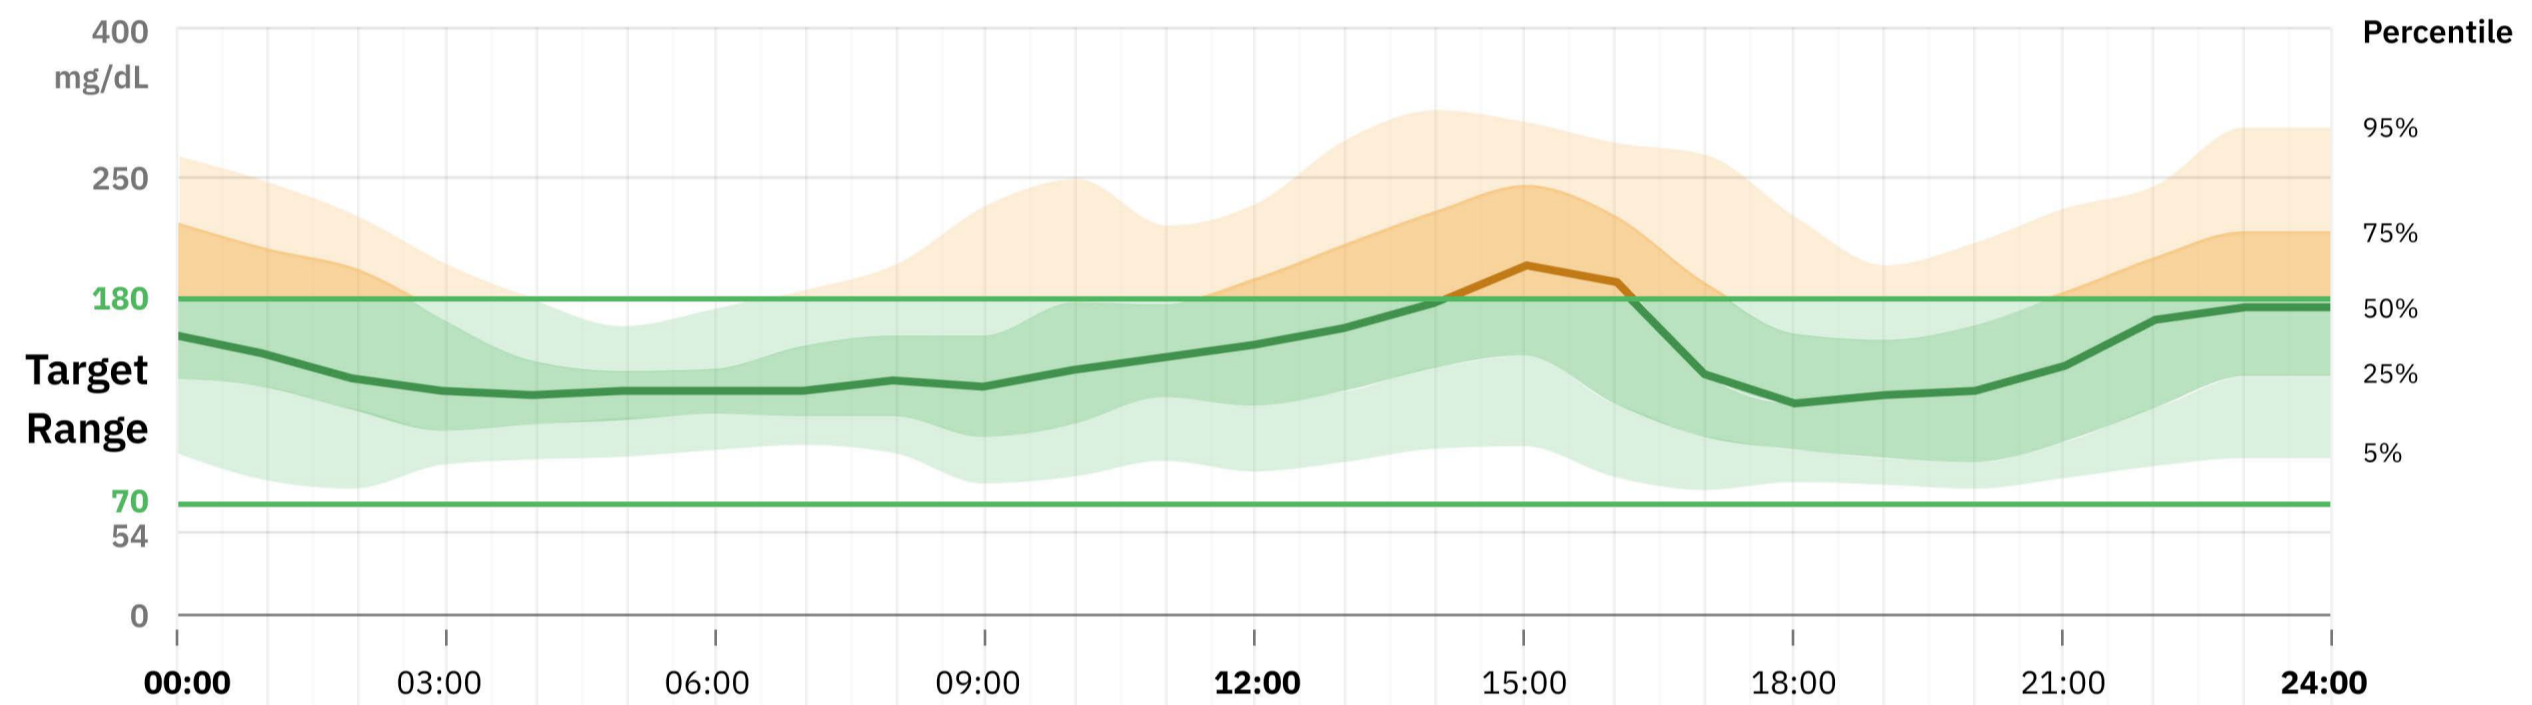

Bolus (Avg no. of boluses/day: 6.5)

Nighttime Avg no. of boluses/day: 0.1	Morning Avg no. of boluses/day: 1.9	Afternoon Avg no. of boluses/day: 2.3	Evening Avg no. of boluses/day: 2.2
--	--	--	--

Omnipod 5 Settings


Duration of Insulin Action **3 hrs**

00:00 - 03:00	110	Target Glucose (mg/dL)
03:00 - 06:00	110	Correct Above (mg/dL)
06:00 - 09:00	1:9	Insulin to Carb Ratio (unit:grams)
09:00 - 12:00	1:10	Correction Factor (unit:mg/dL)
12:00 - 15:00	1:8	
15:00 - 18:00	1:50	
18:00 - 21:00		
21:00 - 24:00		

Insulin Summary


Avg Total Daily Insulin: **27.1 U**

Basal/Day
54%
14.5 U

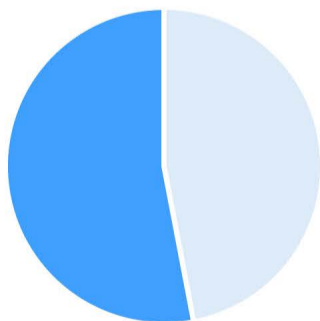

Bolus/Day
46%
12.6 U

Bolus Type

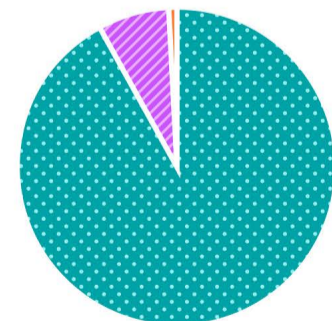

Meal (may include correction)	92.1%	11.6 U
Correction Only	7.1%	0.9 U
Manual	0.8%	0.1 U

Diet

Avg carbs/day
107g

Avg no. of carb entries/day
5.4

Avg no. of boluses/day: **6.5**

User override: **4% of total boluses** (4 boluses over 14 days)

Jane Smith

DOB: 21/11/1988 (36 years old)


14-Day Daily Report

06/03/2025-20/03/2025 | Report Generated: 20/03/2025


Legend

Glucose	Bolus	Insulin Delivery	Pod
● Sensor Value and Trend	▲ User Override Up	Meal Bolus	Max Delivery
■ Manually Entered	▼ User Override Down	Correction Bolus Only	Insulin Paused
⋯ Target Glucose	Extended	Manual Bolus	Temp Basal
		Automated (A)	Pod Change
		Manual (M)	
		Activity (a)	
		Limited (L)	


Thursday, 06/03/2025

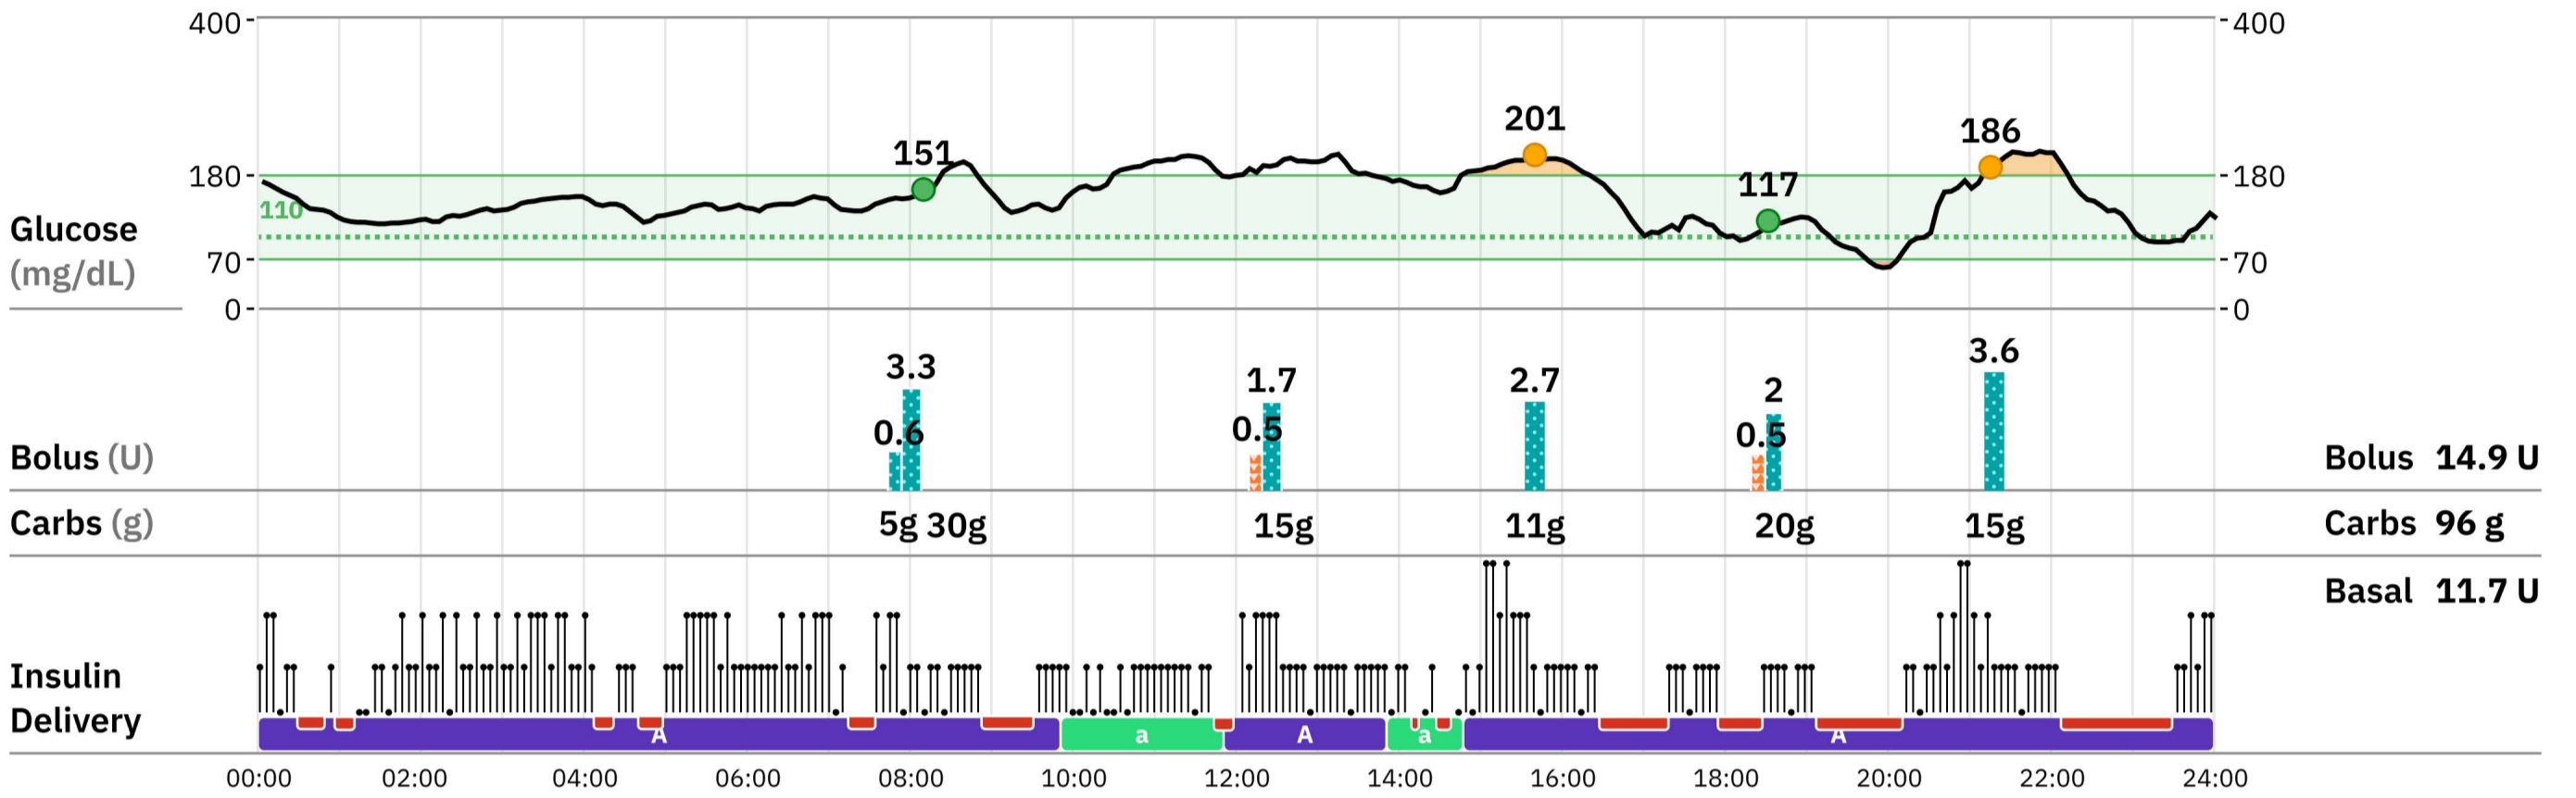

Friday, 07/03/2025

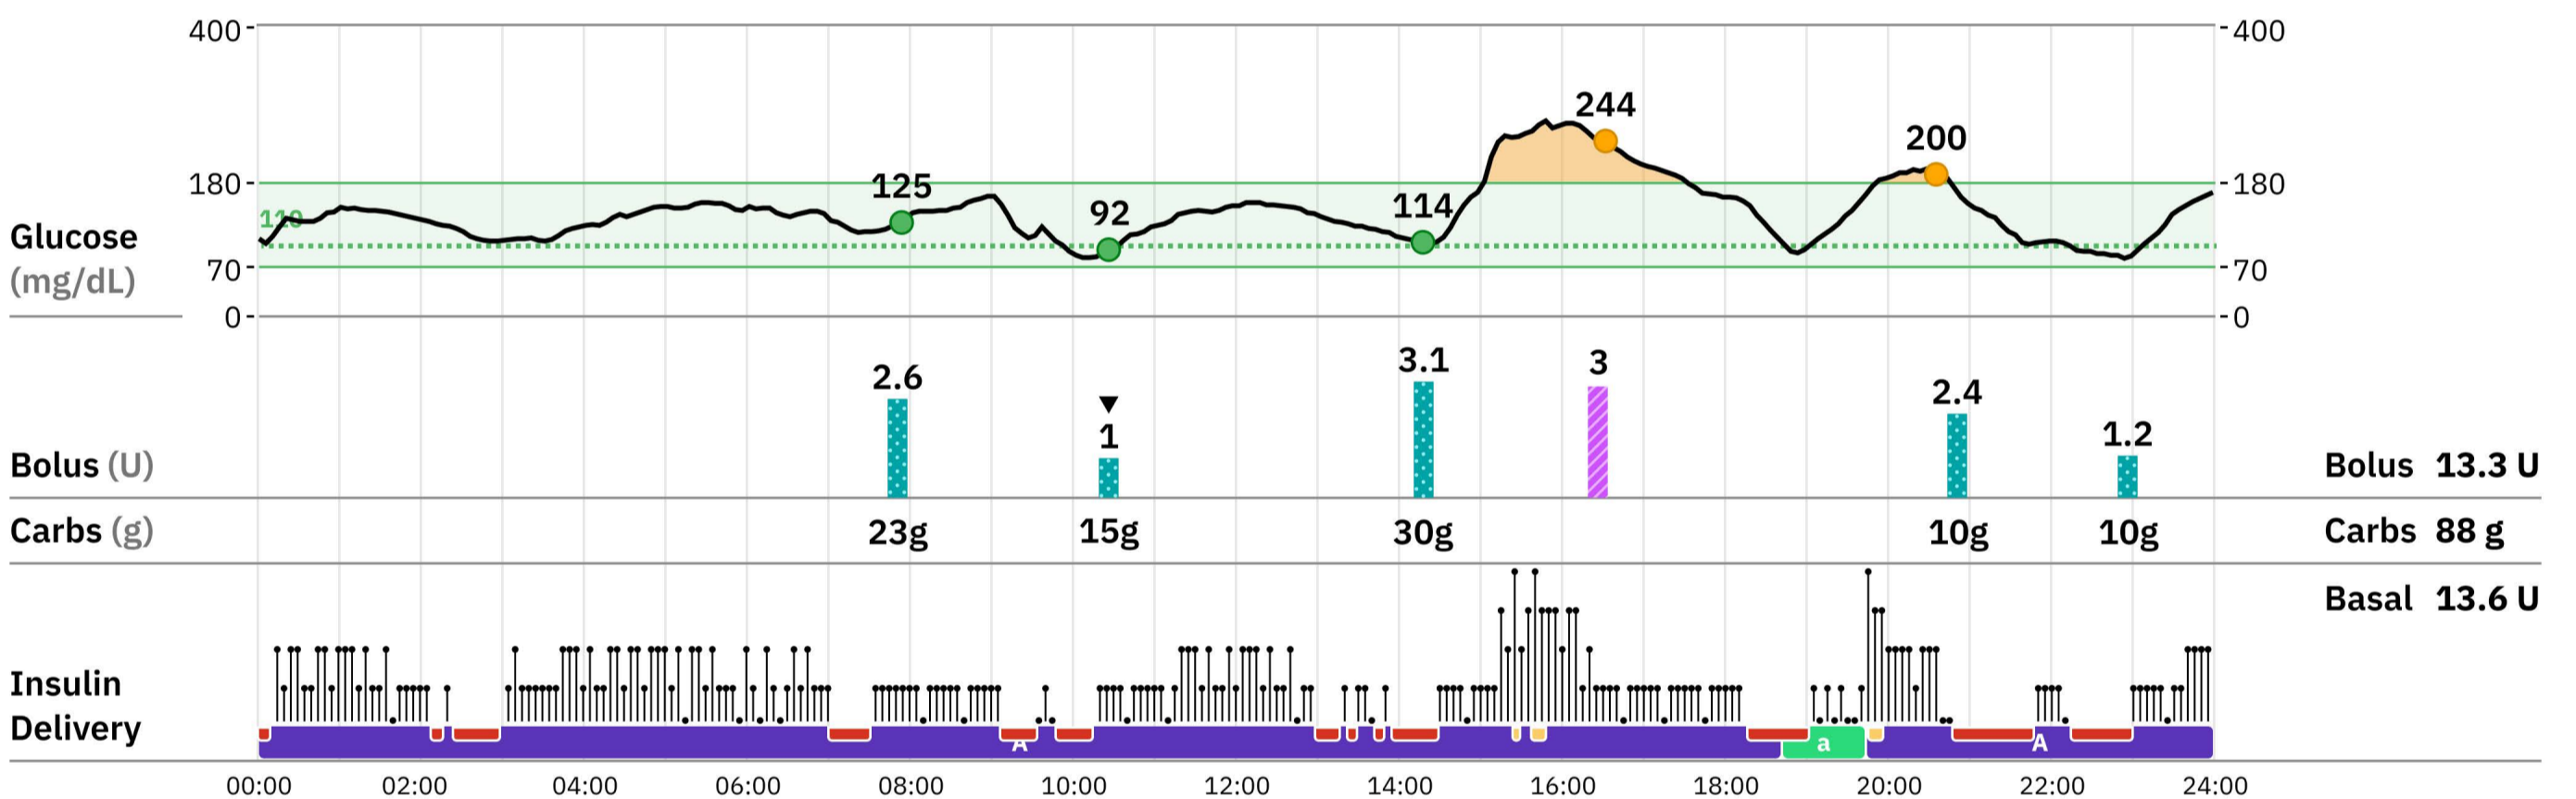

Saturday, 08/03/2025

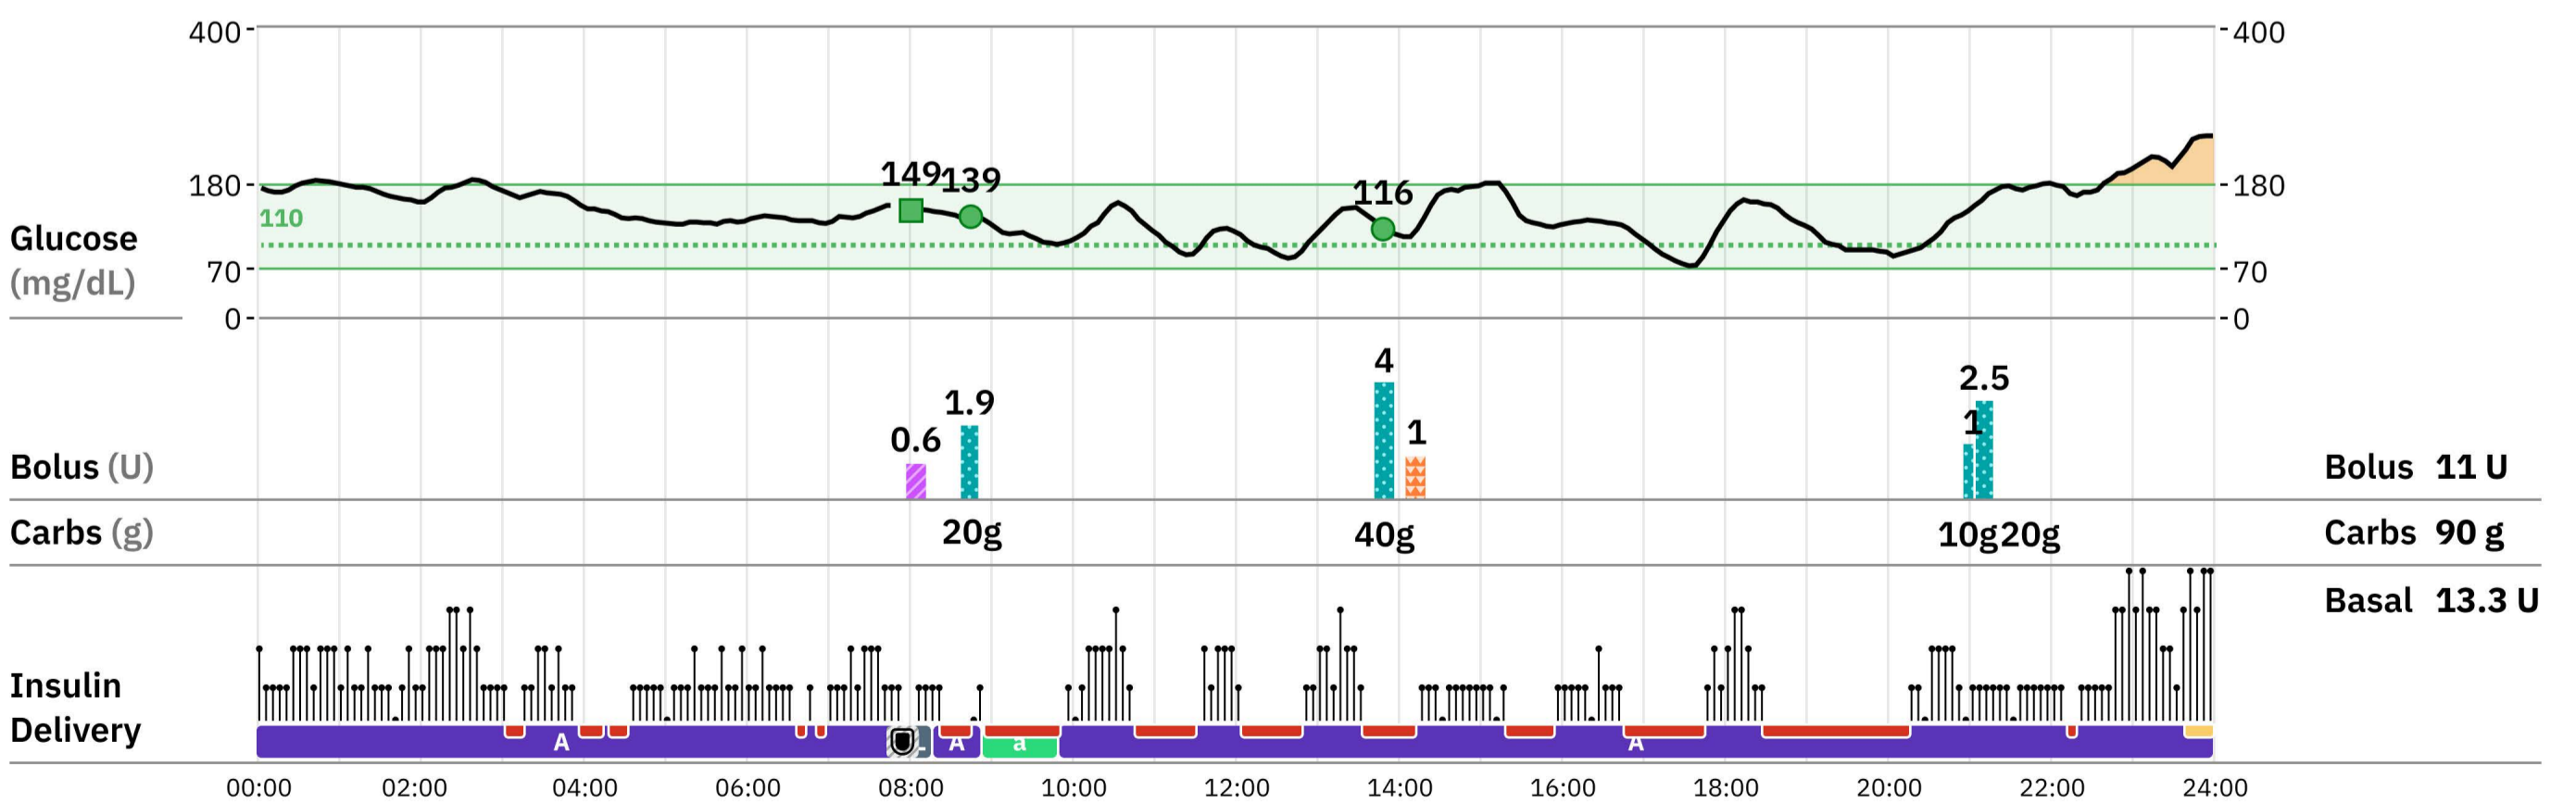

Jane Smith

DOB: 21/11/1988 (36 years old)

Omnipod Discover™

Omnipod 5 Settings

SN: 01040802-000015341 | Report Generated: 20/03/2025 | This page reflects the most recent pump settings

Basal Settings

Changing Basal Programmes only impacts Manual Mode basal delivery.

Max Basal Rate 3 U/hr

Basal Programmes

	Start Time	End Time	Basal Rate
Basal 1 (Active)	00:00	19:00	0.6 U/hr
	19:00	00:00	0.85 U/hr
			Total Basal 15.65 U/day

Temporary Basal Enabled ON

Bolus Settings

When using Automated Mode, the main adjustable setting that directly impacts automated insulin delivery is Target Glucose. The SmartBolus Calculator settings below impact suggested bolus doses in both Automated and Manual Mode.

	Start Time	End Time	Target Glucose	Correct Above
Target Glucose & Correct Above	00:00	00:00	110 mg/dL	110 mg/dL

	Start Time	End Time	1 U of Insulin Covers
Insulin to Carb (IC) Ratio	00:00	16:00	9 g of carbs
	16:00	21:00	10 g of carbs
	21:00	00:00	8 g of carbs

	Start Time	End Time	1 U of Insulin Lowers Glucose By
Correction Factor	00:00	00:00	50 mg/dL

Duration of Insulin Action	3 hours
----------------------------	---------

Max Bolus	8 U
Extended Bolus	ON
Min Glucose for Calculation	70 mg/dL
Reverse Correction	OFF